

DIVISION 15 - MECHANICAL

Section 15510 - Hydronic Piping and Specialties

Introduction

Piping and specialties associated with heat transfer equipment including:

CHILLED WATER, PROCESS COOLING WATER, CONDENSER WATER, HEATING WATER

Part 1 - General

- Install a strainer with differential pressure transmitter to EMCS on building side of isolation valve for chilled water supply from tunnel system. Install a single pressure gauge across strainer (see Section 15050 requirements).
- Use reverse return piping concept and eliminate balancing devices for all banked coil applications.
- Use circuit setting devices in closed loop systems. Preferred design is a variable flow pumping system controlling system differential pressure and using externally adjustable pressure dependent circuit setters at each point of use.
- Provide 3-way valves in heating water piping at end of branch line units only.
- Design heating water systems with a 40°F temperature differential. – (140 °F- 180 °F)
 - Refer to meter requirements (attachment to Section 15970).
- Refer to section 15990 for testing requirements.

Part 2 - Products

- Pipe Schedule

Size	Pipe	Fittings	Joints
Above ground			
Up to 2"	Copper Type "L" seamless hard drawn	Wrought copper	Less Than 0.2% Lead Alloy Solder
2 ½:" and larger	Copper Type "L" seamless hard drawn	Wrought copper	15% silver brazed
	OR		
	Schedule 40 Black steel	Forged Carbon Steel	Bevel Welded
Below ground			
Up to 2"	Copper Type "K" seamless hard drawn	Wrought copper	6% silver solder
2 ½:" and larger	Copper Type "K" seamless hard drawn	Wrought copper	15% silver brazed
	OR		
	Ductile iron	Ductile iron	Push-on or Mechanical


- Pipe Gasketing - Water Services - Garlock or UA approved equal.
- Valve Types: Butterfly, Globe or Ball. No Gate Valves shall be used.

- Preferred manufacturers are Norris, Centerline or UA approved equal.
- Thermometers
 - Adjustable angle type 9" die cast aluminum thermometer with separable well. Select with normal operating range at the midpoint of the scale. Install thermometer on both sides of each flow stream across coils, heat exchangers, etc.
- Pressure Gauges
 - Cast aluminum with 4 ½" dial. Select with normal operating range at the midpoint of the scale. Provide with pressure snubber and shutoff valve.
 - Provide gauges at each pump, AHU coil, and heat exchanger.
 - Use a single gauge manifold with valving on each side of equipment.
- Expansion Tanks
 - Provide diaphragm-type compression tank with replaceable diaphragm.
- Air Vents
 - Provide automatic float and trap air vents in mechanical rooms only.
- Expansion Joints
 - Provide bellows type. Type 316 stainless steel.
- Pressure Regulators
 - Brass body, threaded connections.
- Flow Regulating Devices
 - Circuit setter with external adjustment and indicator with threaded connections only.
 - Pressure independent flow balancing - restrict use to areas approved by the U of A.
- Hoses
 - High pressure, braided stainless steel and rated for temp and pressure requirements.

Part 3 - Execution

- Weld inspection: see Specification 15050 Part 3 Execution.
- Perform a minimum of three passes on weld joints (root, filler, cap).
- Route piping to allow sufficient access to all equipment, valves, controls, etc., for maintenance.
- In general, piping shall be installed below electrical conduits not requiring maintenance access.
- Piping shall be secured at each trapeze hanger or support.
- Install piping sufficiently below structure to allow top air vents.

- Provide isolation valves on each side of strainers and full port ball valve on blow down. Provide hose thread connection on blow down port $\frac{3}{4}$ " and below.
- Provide air vent with isolation valve at all system high points. Install automatic air vents in equipment rooms and manual air vents elsewhere. Automatic air vents are to be piped to drain. Minimum vent piping size is $\frac{1}{2}$ ".
- Provide ball valves with hose end threads for system drains.
- When an existing system "hot tap" is necessary, provide a full port ball valve to isolate the new branch line.
- Do not use circuit setter as isolation valve.

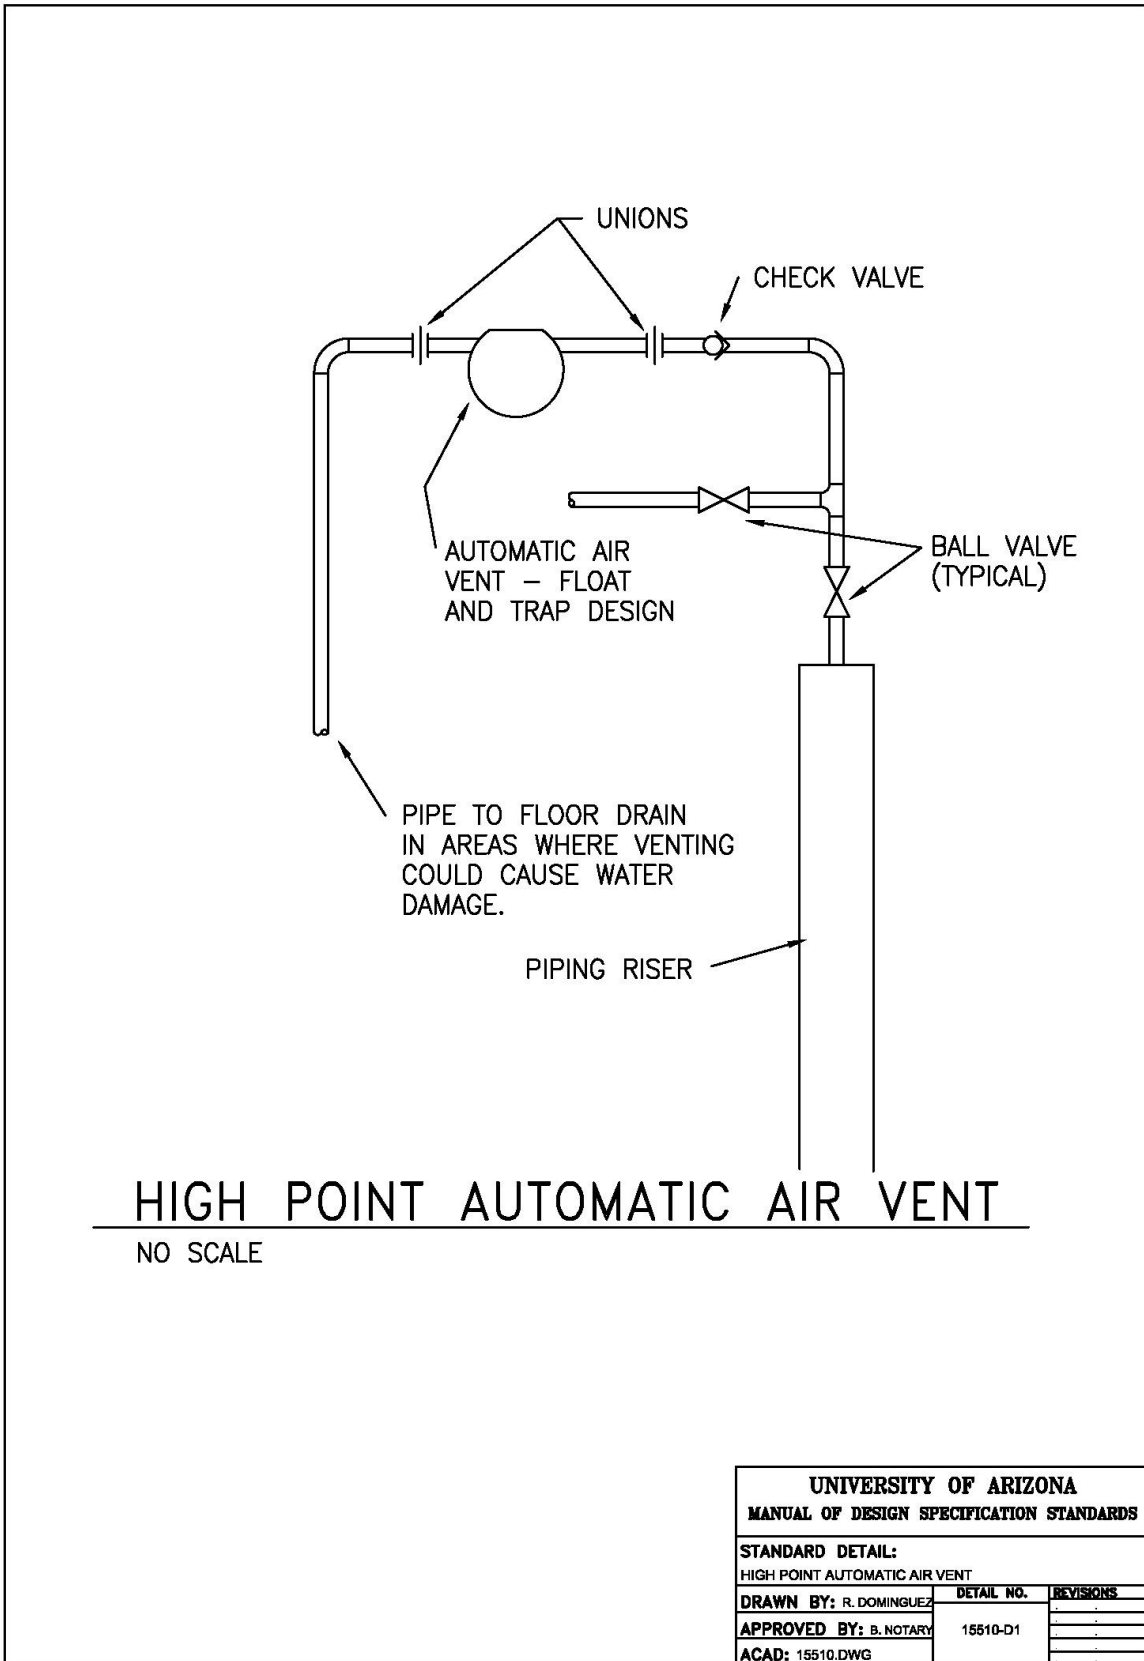

End of Section 15510